


**ELECTRICIANS!!:**  
 Always contact Engineering Dispatch, or District Manager before installing your service entrance. They will tell you specifications for length of conduit.

Temp shall be on right hand side when facing front of underground transformer

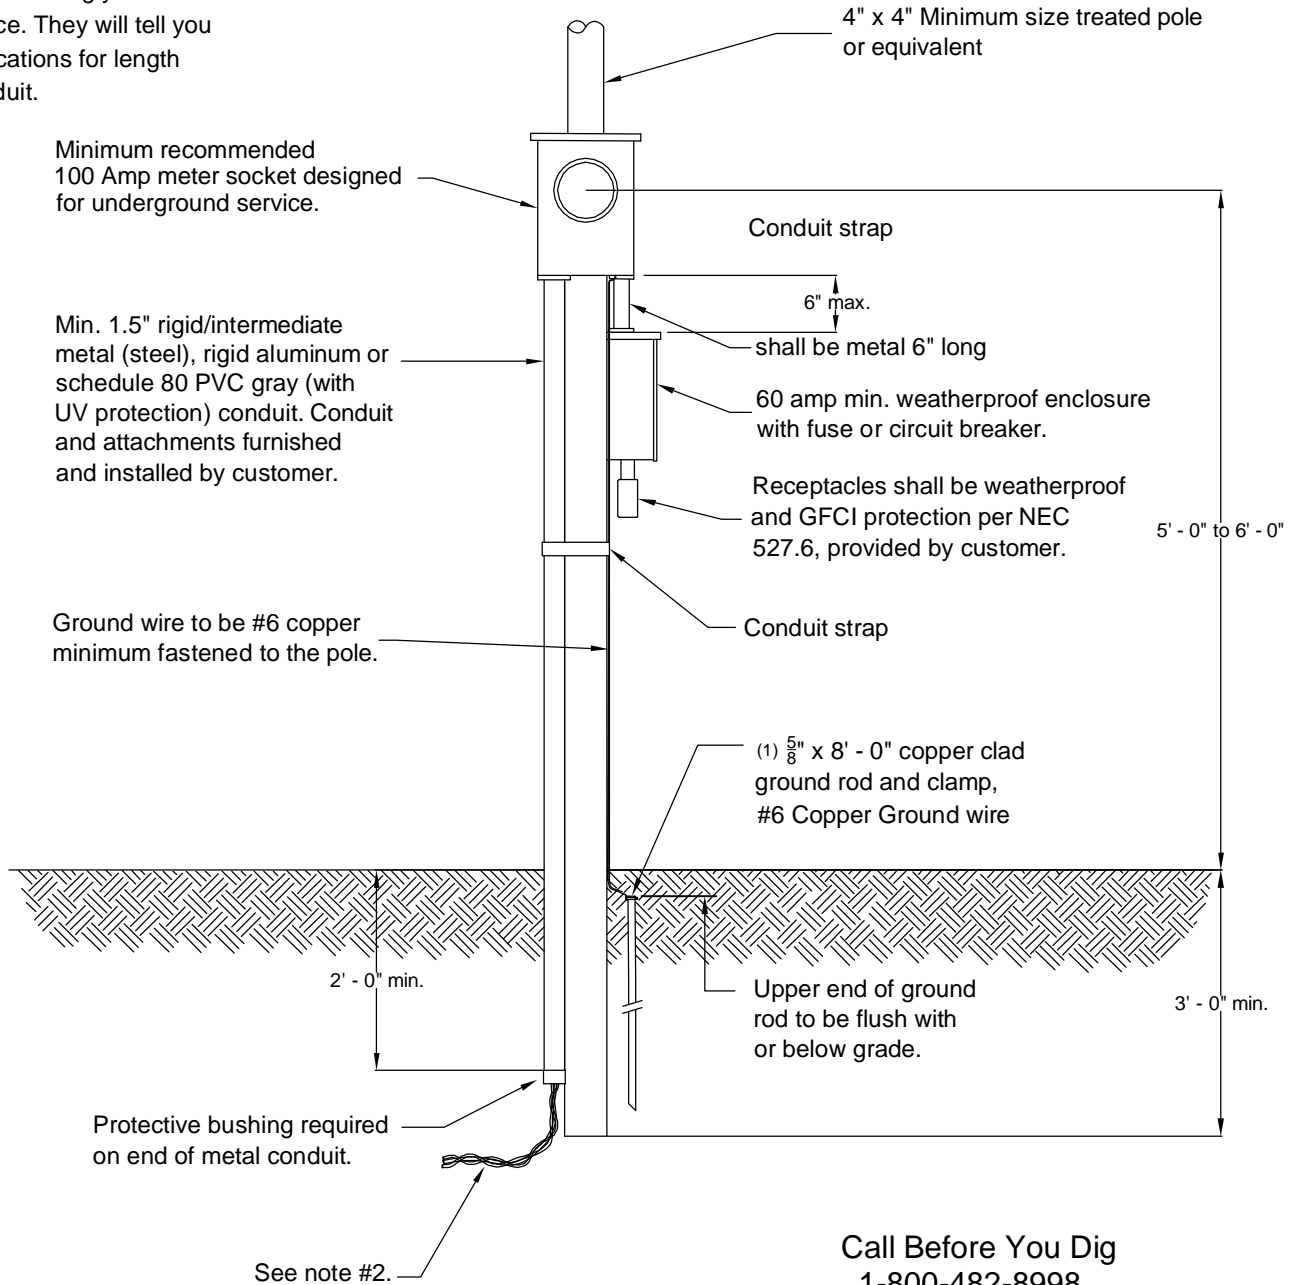


**Call Before You Dig**  
 1-800-482-8998

In location with underground facilities, the Customer shall notify Arkansas One Call and shall have One Call locate all underground facilities before digging. It shall be the responsibility of the Customer to stay clear of all underground facilities.

**NOTES:**

1. Customer facilities shall comply with the National Electrical Code and authorities having jurisdiction.
2. Customer provides minimum wire size of #6 copper. Service wire suitable for direct burial to be furnished, installed and maintained by customer. Customer to tail out enough service wire to reach inside of pedestal or transformer.
3. All conduit connections to be raintight.
4. Customer to trench to within 12" of pedestal or transformer. Minimum depth of trench is 24".
5. Location of underground cables shall be identified prior to digging.

NEC = National Electric Code  
 Current Code Requirements.

<b>CRAIGHEAD ELECTRIC COOPERATIVE</b>	
<b>TEMPORARY SERVICE FROM AN UNDERGROUND SOURCE</b>	
APPROVED BY: KB	DATE: 5-24-11
CHECKED BY: KB	SCALE: none
DRAWN BY: mbarnes	
	
DWG NO.: 1201	